
# DHB Series

## DHB 530B 1D5


Technical datasheet

## Dereike blower performance curves


### Vacuum selection diagram curve

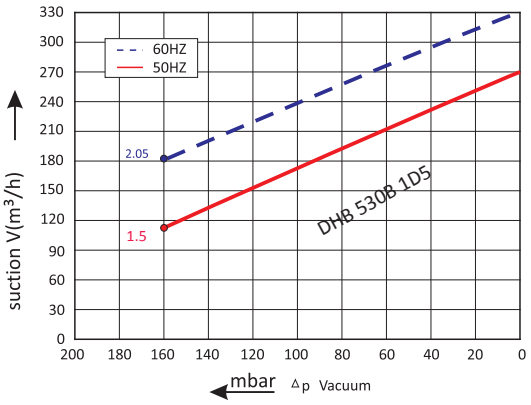


### Compressor selection diagram curve

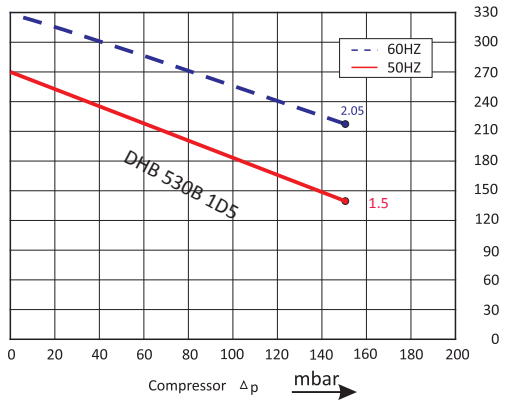


## Dereike blower installation drawing

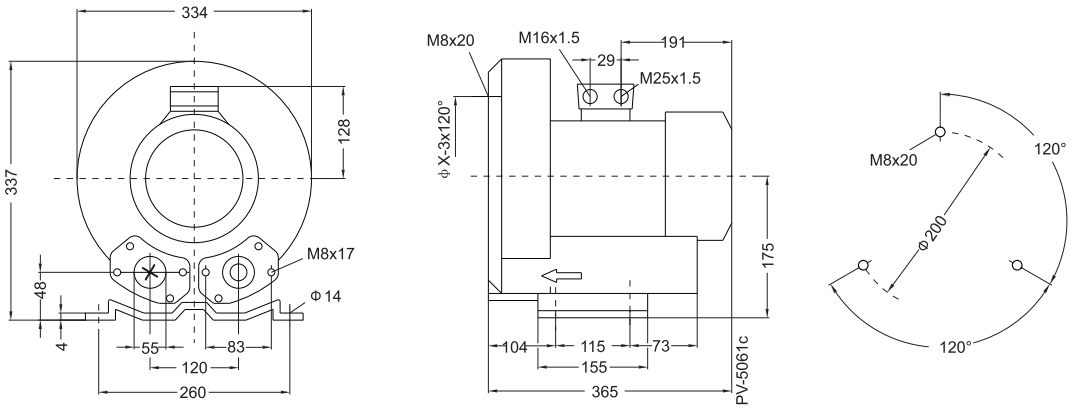


## Dereike blower installation parameter

| Model | Frequency | Output | Voltage | Current | Airflow | Pressure | | Noise | Weight |
|---|---|---|---|---|---|---|---|---|---|
| | HZ | KW | V | A | m³/h | vacuum mbar | compressor mbar | dB(A) | |
| DHB 530B 1D5 | 50 | 1.5 | 200-240△/345-415Y | 7.5△/4.3Y | 270 | -160 | 150 | 65 | 22 |
| | 60 | 2.05 | 220-275△/380-480Y | 7.6△/4.4Y | 330 | -160 | 150 | 71 | 22 |

The performance curves of Dereike blower is tested through below ways:

Under one atmospheric pressure, suck 15℃ air and then you can calculate the data, of course allow 10% difference, and when the sucked air and surroundings temperature are not higher than 25℃, you still can get total pressure difference as the curves shows.


Dongguan Dereike Intelligent M and E Equipment Co., Ltd

Address: Building 2, CaiBai Street 3, CaiBai Village, Daojiao Town,Dongguan City, 523170, China.

Mobile/Whatsapp/Wechat: 0086 13826960346 Email: info@dereike.com Website: http://www.dereike.com